


| KITCHENAID, KA, 86, 012 | |
|-----------------------------------|--|
| |  |
| 12NC | 851352401100 |
| Commercial code | KOXCS 60900 |
| Grids type | KitchenAid |
| Cleaning system | Catalytic partial |
| Product segment | Premium |
| Antifingerprint | Yes-inox market |
| Function | |
| Number of cavities | 1 |
| Shelves type | KitchenAid (3 levels) |
| Door glass type | Black |
| Hinge type | Self closing |
| User interface color | White |
| Type of display | 7 segment |
| Knob type | Impact |
| Panel material | Stainless steel |
| Handles type | Impact |
| Knob color | Inox |
| Number of glasses in door | 2 |
| Type of light | Halogen (40W) |
| Door frame | Impact |
| Knob number | 2 |
| Type of Control | Mechanical & electronic |
| Controls (CMG) | Clock |
| Range | super premium |
| Kind of timer | Electronic |
| Type of Display | 7 Segment |
| IFU Language Requested | AR, Arabic, AR, ar_SA; EN, English, GB, en_UK; WEST, FR, French, F, fr_FR |
| Energy input | Gas |
| Type of energy | Gas |
| Adjustable feet | No |
| Grids | 2 |
| Are any hobs controls integrated? | No |
| Cavity material | Enamelled |
| Motorized turn spit | Yes |
| Number of interior lights | 1 |
| Oven guides | Grids |
| Position of interior lights | Rear |
| Probe | No |
| Timer | Minute minder |
| Time control | Mechanical |
| Trays | 1 |
| Bottom front trim mounted | Yes |

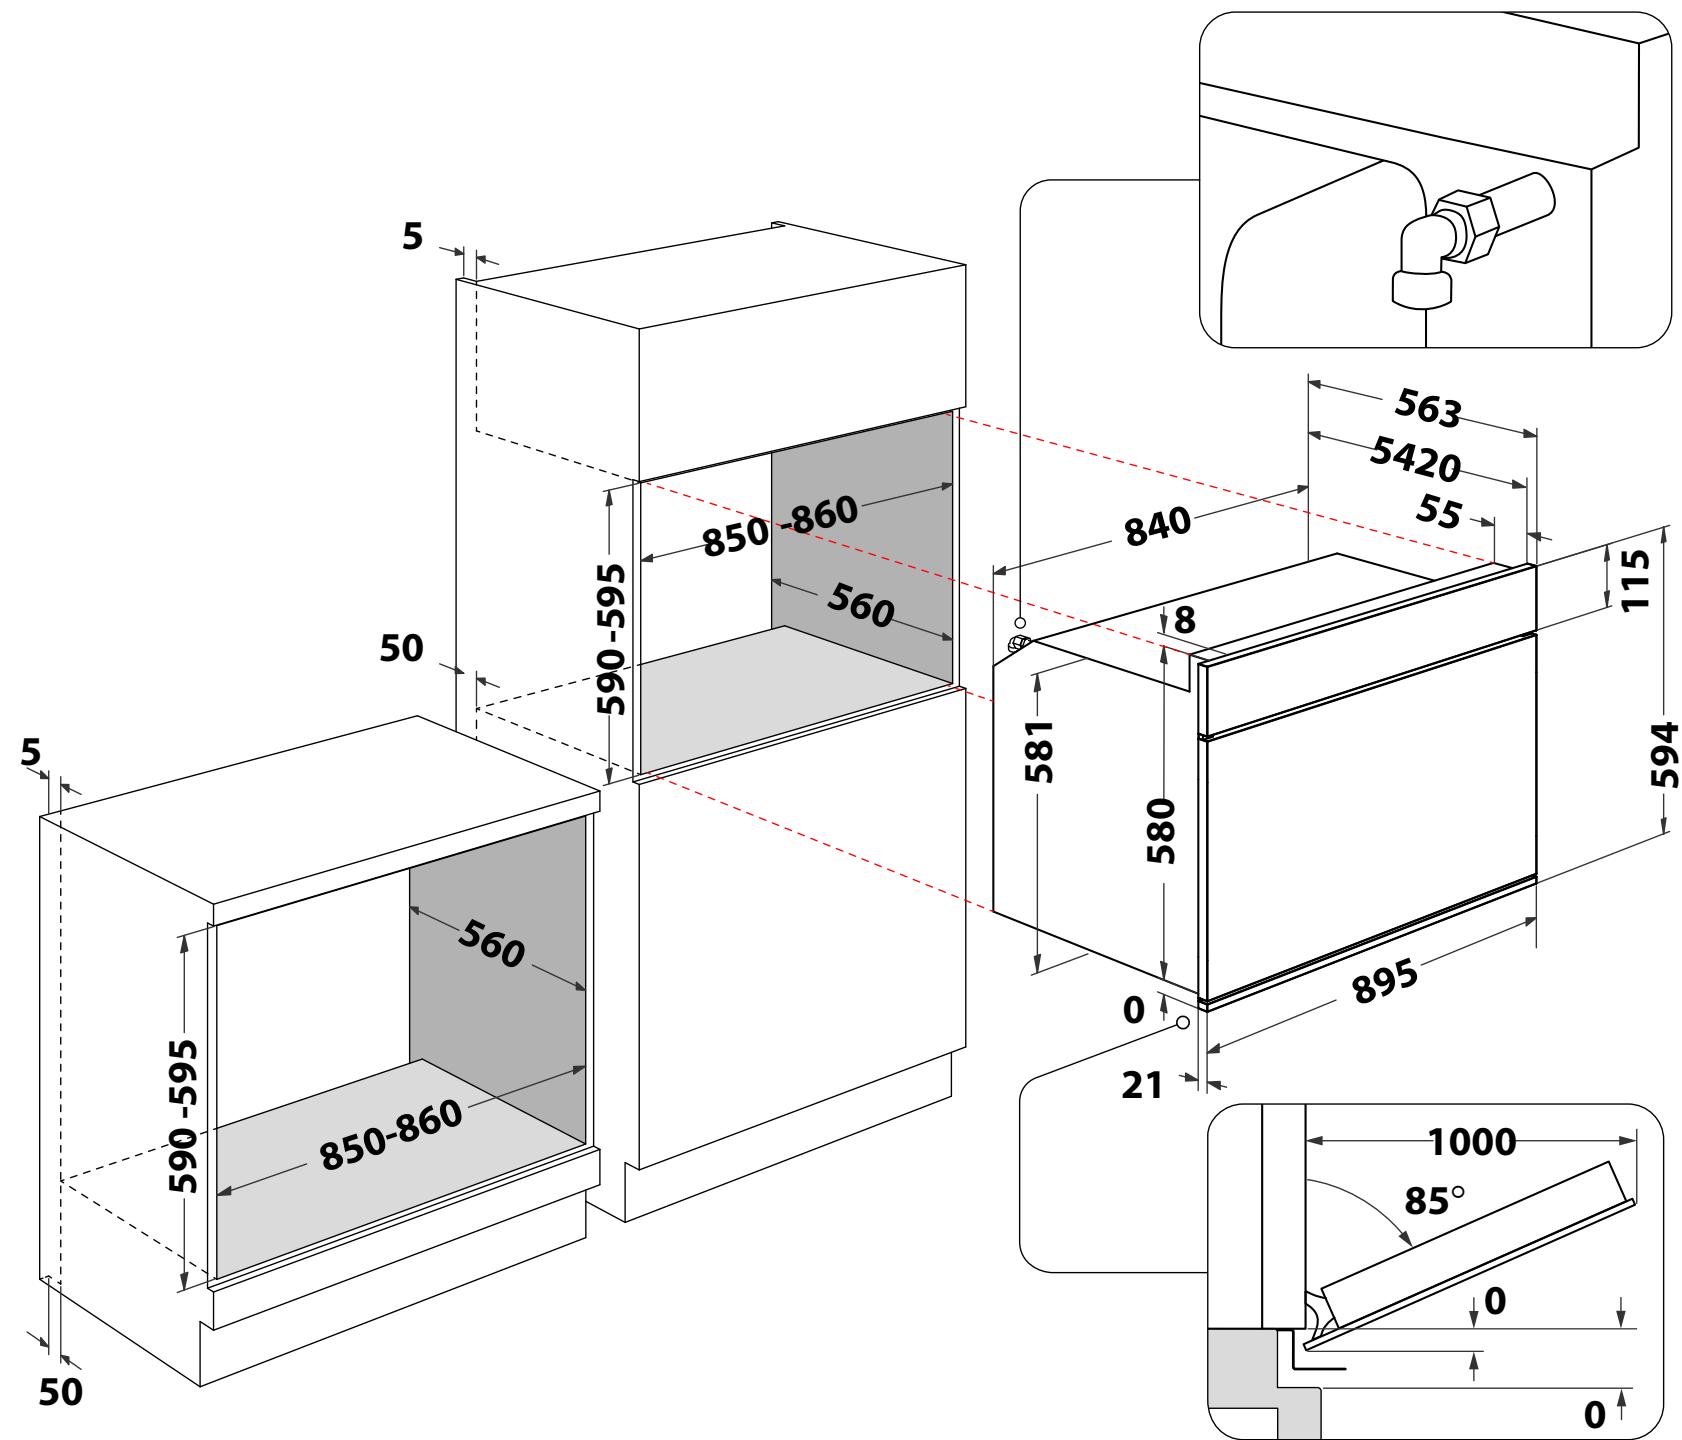

KOXCS 60900**12NC/Fx: 851352401100****GTIN (EAN) code:****8003437223112**

| DIMENSION | MEASURE | DIMENSION | MEASURE |
|--|---------------------|---|----------------|
| OVERALL CABINET | | APPLIANCE | |
| MIN Height of the wall cabinet niche, including all required space for installation or ventilation | 0 mm | Height of the front | 594 mm |
| MIN Height of the tall cabinet niche, including all required space for installation or ventilation | 590 mm | Width of the front | 895 mm |
| MIN Height of the base cabinet niche, including all required space for installation or ventilation | 590 mm | Depth of the front | 21 mm |
| MAX Height of the wall cabinet niche, including all required space for installation or ventilation | 0 mm | Maximum depth all protruding elements, e.g. handles, controls | 50 mm |
| MAX Height of the tall cabinet niche, including all required space for installation or ventilation | 595 mm | Lateral clearance between front edge and most protruding elements which avoid to open a neighbour front more than 90 degrees | 153 mm |
| MAX Height of the base cabinet niche, including all required space for installation or ventilation | 595 mm | Projection of front in relation to housing of appliance | 8 mm |
| MIN Width of the wall cabinet niche, including all required space for installation or ventilation | 0 mm | Projection of front in relation to bearing area of the appliance. Taken at minimum height of appliance, if height is adjustable | 0 mm |
| MIN Width of the tall cabinet niche, including all required space for installation or ventilation | 850 mm | When product panel is missing, set to 0 | 115 mm |
| MIN Width of the base cabinet niche, including all required space for installation or ventilation | 850 mm | Space in front, which is required to guarantee full operability. The most protruding part gives this dimension | 1000 mm |
| MAX Width of the wall cabinet niche, including all required space for installation or ventilation | 0 mm | Height from bearing area of appliances and lower handle | 419 mm |
| MAX Width of the tall cabinet niche, including all required space for installation or ventilation | 860 mm | Frontal handle thickness | 29 mm |
| MAX Width of the base cabinet niche, including all required space for installation or ventilation | 860 mm | Frontal handle width | 588 mm |
| MIN Depth of the wall cabinet niche, including all required space for installation or ventilation | 0 mm | MIN Height of the product body | 581 mm |
| MIN Depth of the tall cabinet niche, including all required space for installation or ventilation | 560 mm | MAX Height of the product body | 580 mm |
| MIN Depth of the base cabinet niche, including all required space for installation or ventilation | 560 mm | Width of the product body | 840 mm |
| Space in front, which is required to install bottom trim | 0 mm | Depth of the product body | 5420 mm |
| Indicates whether a ventilation opening is needed or not. Default is "N" | Yes | Full depth of product excluding protruding interface elements | 563 mm |
| WALL CABINET (vent-shaft incoming) | | - | - mm |
| Indicates the position of the freespace for the inbound airflow (wall cabinet) | - | - | - mm |
| Minimum space or inbound ventilation (wall cabinet) | 0 mm | - | - mm |
| Minimum area for inbound ventilation cavity (wall cabinet) | 0 cm ² | - | - mm |
| WALL CABINET (vent-shaft outgoing) | | - | - mm |
| Indicates the position of the freespace for the outbound airflow (wall cabinet) | - | - | - mm |
| Minimum space or outbound ventilation (wall cabinet) | 0 mm | - | - mm |
| Minimum area for outbound ventilation cavity (wall cabinet) | 0 cm ² | - | - mm |
| TALL CABINET (vent-shaft incoming) | | - | - mm |
| Indicates the position of the freespace for the inbound airflow (tall cabinet) | Rear | - | - mm |
| Minimum space for inbound ventilation (tall cabinet) | 50 mm | - | - mm |
| Minimum area for inbound ventilation cavity (tall cabinet) | 292 cm ² | - | - mm |
| TALL CABINET (vent-shaft outgoing) | | - | - mm |
| Indicates the position of the freespace for the outbound airflow (tall cabinet) | Front | - | - mm |
| Minimum space for outbound ventilation (tall cabinet) | 5 mm | - | - mm |
| Minimum area for outbound ventilation cavity (tall cabinet) | 45 cm ² | - | - mm |
| BASE CABINET (vent-shaft incoming) | | Appliance Flap door | |
| Indicates the position of the freespace for the inbound airflow (base cabinet) | Rear | Projection of the opened flap in relation to bearing area | 0 mm |
| Minimum space for inbound ventilation (base cabinet) | 50 mm | Maximum angle when flap door is opened totally | 85 mm |
| Minimum area for inbound ventilation cavity (base cabinet) | 293 cm ² | Appliance Side swing door | |
| BASE CABINET (vent-shaft outgoing) | | Lateral projection of front incl. controls when door is opened totally. At the side where the hinge is mounted | 0 mm |
| Indicates the position of the freespace for the outbound airflow (base cabinet) | Front | Lateral projection of opened front at the side where the hinge is fixed | 0 mm |
| Minimum space for outbound ventilation (base cabinet) | 5 mm | Maximum angle when door is opened totally | 0 mm |
| Minimum area for outbound ventilation cavity (base cabinet) | 45 cm ² | Appliance other | |
| | | Depth from front end of the niche to the front end of the freespace of the retrace | 55 mm |
| | | Height from niche to bottom end of freespace for the retrace | 581 mm |